


SNR-070 Range

0 - 5#

SNR-071 Range

0 - 10#

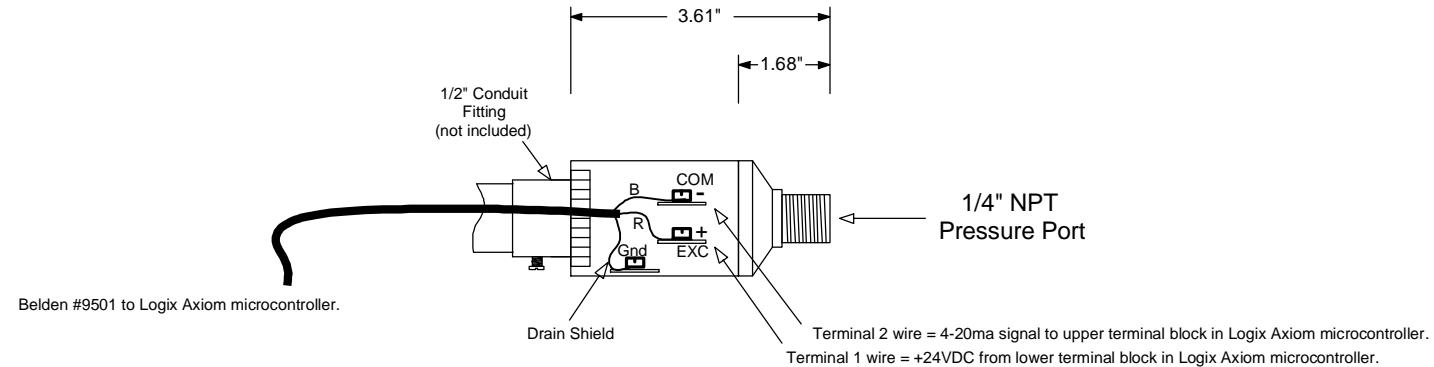

NOTES:

- 1) Requires 2 conductor #24 AWG shielded cable Belden 9501 or equal up to 2000' in length. Ground shield at control panel end only. Insulate shield at sensor end.
- 2) Installation of a service valve for replacement and maintenance is strongly recommended. Attached electrical conduit must be fully supported - the sensor must not carry any of the conduit's weight. Avoid mounting in a prone position in which the sensor can be damaged or broken off.



© Copyright 2019 Logix®. All Rights Reserved.		
CONFIDENTIAL: The information herein is confidential and may NOT be reproduced or divulged without the written permission of The Controls Group, Inc. LOGIX is a registered trademark of The Controls Group, Inc.		
Title	ACI Pressure / Level Sensor	Wiring & Installation Detail
Date	4/19/2019	Rev 01 Drawn by NRJ
Drawing	Filename	Pressure/Level_ACI.axd